

1/8-DIN DUAL COLOUR DISPLAY TEMPERATURE INDICATOR CONCISE PRODUCT MANUAL (59230-4)

OPERATING MODE


NOTE: Set all Configuration Mode and Program Mode parameters before starting normal operations.

Front Panel




Key/Display/Indicator	Function
Down key (↓)	In Edit Mode, decrements the flashing digit in the Primary Display.
Scroll key (→)	Puts Indicator into Edit Mode; in Edit Mode, selects digit to be altered (selected digit is flashing) in Primary Display. Wrap-around occurs from right-most digit to left-most digit.
Program Key (PGM)	Selects parameter to be viewed/edited. In Edit Mode, confirms changed parameter value.
Reset key (RST)	If the process variable is displayed, resets the latched Alarm 1. If the Maximum (High) Value, Minimum (Low) Value or Alarm 1 Elapsed Time is displayed, resets the displayed parameter.
Down (↓) and Scroll (→) keys	If pressed simultaneously in Edit Mode, will abort the Edit operation and will restore the parameter to its initial value.
Primary Display	Normally displays the process variable value. Displays other Operation Mode parameters when the Program (PGM) key is used. If the Help Facility is enabled (see Subsection), this display shows the parameter description for three seconds before displaying the parameter value.
Secondary Display	Shows a single-character identifier for the parameter value being displayed (blank for process variable).
OP1 indicator	ON when Alarm 1 is active.
OP2 indicator	ON when Alarm 2 is active.

Parameter Sequence

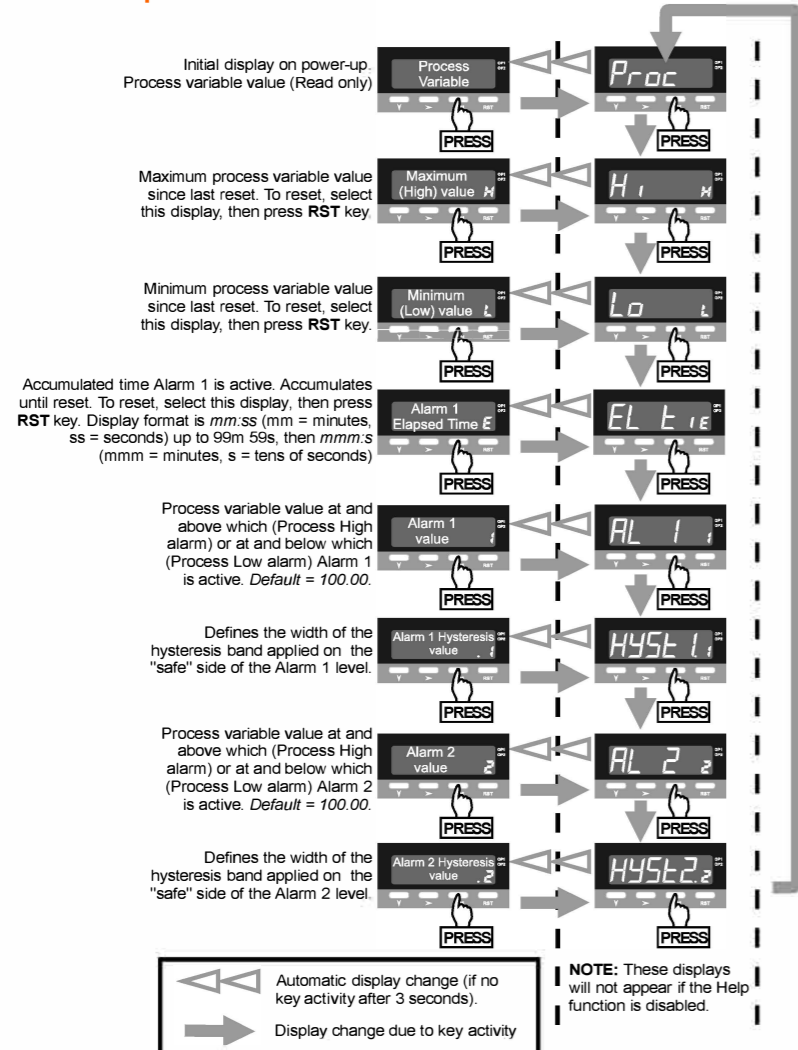

Error/Fault Indication

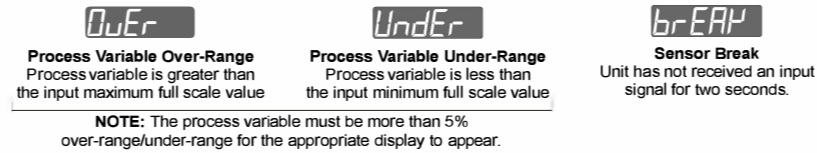

Alarms

NOTE: Alarm values cannot be changed if Alarm Lock is enabled (see PROGRAM MODE).

PROGRAM MODE

Changing an Alarm Value

- Select required alarm value display:
- Left-most digit flashes
- Use Down key to change value of flashing digit, if required.
- Next digit flashes
- Repeat Steps 3 and 4 for each digit, as required.
- When adjustment is complete, confirm new value:

All digits will stop flashing.

Resetting a Latched Alarm


If Alarm 1 is configured to be a latched alarm relay, when it is active, it may be reset as follows:

- Select PV display:
- Press **NOTE:** The latched alarm cannot be reset whilst the alarm condition persists.


Alarm Hysteresis Operation

Note: Hysteresis is adjustable; 0 to 100% of span


To enter Program Mode from Operator Mode:

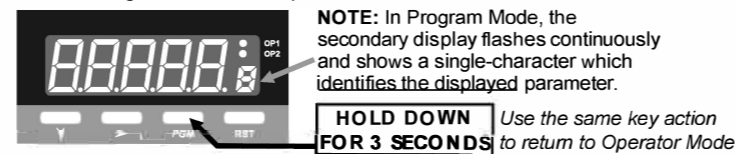


Parameter Selection (Help Facility Enabled)

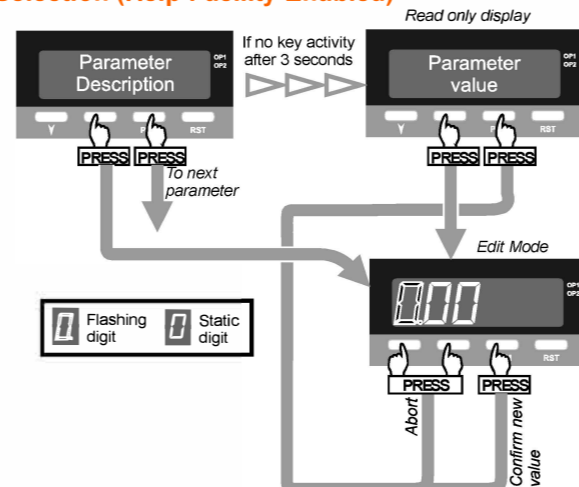

Parameter Selection (Help Facility Disabled)

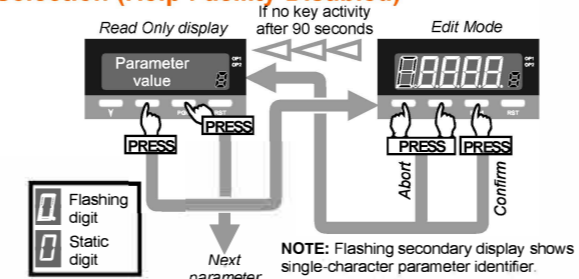

Editing the Displayed Parameter (Edit Mode)

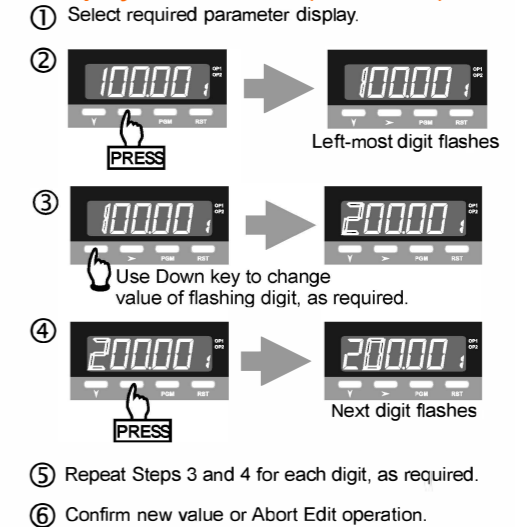

Program Mode Parameter Sequence

Primary Display	Identifier	Description	Adjustment Range
rt Lo	↔	Re-transmission Scale Minimum: The lower end of the linear scale for the re-transmission output, expressed as the value corresponding to the minimum output signal.	-19999 to 99999
SEE NOTE 1			
rt Hi	↔	Re-transmission Scale Maximum: The upper end of the linear scale for the re-transmission output, expressed as the value corresponding to the maximum output signal.	-19999 to 99999
SEE NOTE 1			
off	↔	Process Variable Offset: Corrects a known offset of the input in order to display more accurately the process value.	-19999 to 99999
Flt	↔	Input Filter Time Constant: Filters the input over a user-definable time period to minimise the effect on the process variable of any extraneous impulses	0.0 (OFF) to 100.0
Addr	↔	Communications Address: The unique serial communications address of the instrument.	1 to 99
SEE NOTE 1			
baud	↔	Baud Rate: Serial communications speed	1200, 2400, 4800 or 9600
Color	↔	Display Colour Change: Defines the colour of the primary and secondary displays prior to/after the preset value (e.g. Alarm level) is reached.	rEd: Red GrEEn: Green Gn-rd: Green to Red rd-Gn: Red to Green
Lock	↔	Alarm Lock: Enables/disables the changing of alarm values via the front panel.	En: Enabled dIs: Disabled
HELP	↔	Help Prompt: Determines whether the Primary Display shows the parameter description for 3 seconds before a parameter value is shown.	HLP Y: Yes HLP N: No

NOTE 1: Only appears if relevant option fitted and configured.

SERIAL COMMUNICATIONS



For information on the serial communications option, consult your supplier.

INSTALLATION

! All installation work should be performed only by personnel who are technically competent and authorised to do so. Local Regulations regarding electrical installation & safety must be observed.


Panel-Mounting

The mounting panel must be rigid and may be up to 6mm (0.25 inches) thick. The cut-out required for the Indicator is shown on the right. Several Indicators may be mounted side-by-side in a multiple installation for which the cut-out width (for n Indicators) is (96n - 4) millimetres. The panel-mounting procedure is shown below.

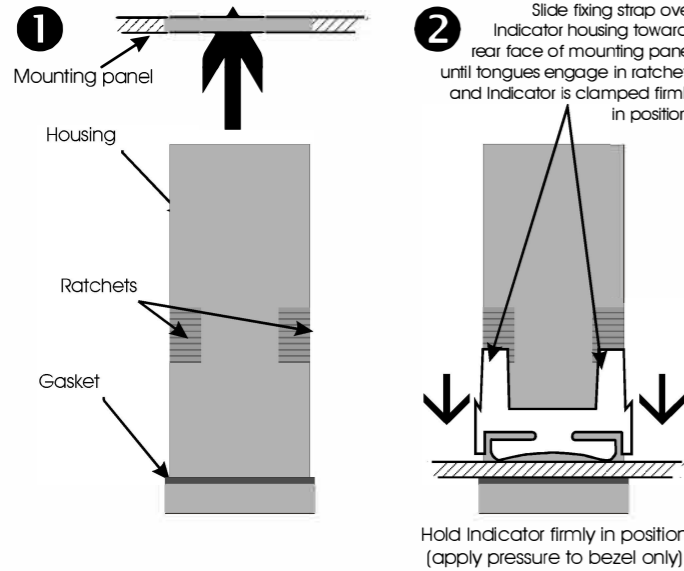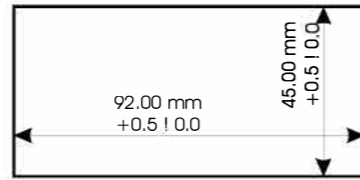

! WARNING: This product can expose you to chemicals including arsenic, which is known to the State of California to cause cancer. For more information go to www.P65Warnings.ca.gov

Rear Terminals

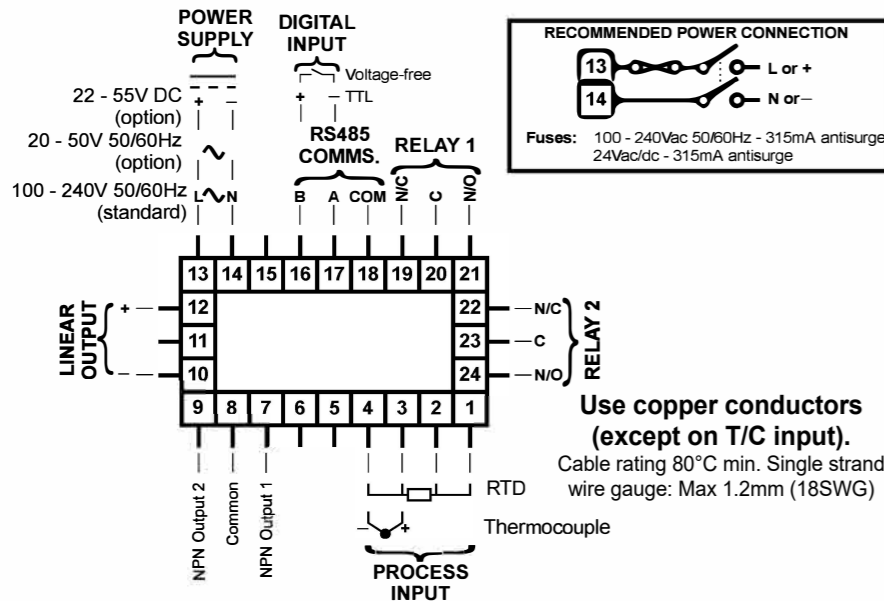


Use copper conductors (except on T/C input).
Cable rating 80°C min. Single strand wire gauge: Max 1.2mm (18SWG)

- Relay 1:** Standard; used as Alarm 1 output.
- Relay 2:** Optional; used as Alarm 2 output.
- Linear output:** Optional; provides a 10-bit re-transmission output (process variable).
- Digital Input:** Optional; used for the Security Facility. The terminals may be connected to (a) voltage-free contacts of an external switch, or (b) a TTL-compatible voltage. Operation is:

Voltage-free	TTL-compatible	Security Facility Status
Contacts open	Signal >2.0V	Entry into Program Mode prohibited
Contacts closed	Signal <0.8V	Entry into Program Mode permitted

Linear (Re-transmitted) Output Range


Range	Link Jumper Fitted
0 - 10V	LJ8
0 - 20mA	LJ9
0 - 5V	LJ8
4 - 20mA	LJ9

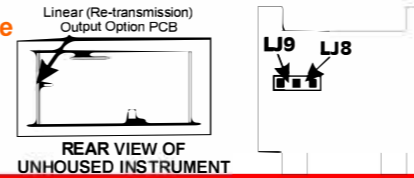

CONFIGURATION MODE

Entry/Exit

Indicator initially in Operation Mode



NOTE: In Configuration Mode, the secondary display flashes continuously and shows a single-character which identifies the displayed parameter.

Use the same key actions to return to Operation Mode.

Parameter Selection and Editing

As previously described (see PROGRAM MODE).

Configuration Mode Parameter Sequence

Primary Display	Identifier	Description	Adjustment Range
InPut	I	Input Range: Selects the input sensor type, resolution and display scale (°C or °F) by means of a code number.	See table below.
rnGh	H	Range Trim High: Adjusts the maximum range value of the input type selected.	Range Trim Low to Range Max. (see table below).
rnGL	L	Range Trim Low: Adjusts the minimum range value of the input type selected.	Range Min. (see table below) to Range Trim High.
FrEQ	F	Power Supply Frequency: applicable to DC-powered units only, this must be set to the mains (line) frequency for the site in order to ensure proper filtering of the input signal.	50: 50Hz 60: 60Hz
AL 1	1	Alarm 1 Type: defines the action of Alarm 1	P_H: Process High P_Lo: Process Low nonE: No alarm
AL 2	2	Alarm 2 Type: defines the action of Alarm 2	P_H: Process High P_Lo: Process Low nonE: No alarm
Out 1	1	Output 1 Usage: Determines how NPN Output 1 and relay Output 1 operate.	A1nd: Alarm 1 non-latching, direct action A1nr: Alarm 1 non-latching, reverse action A1ld: Alarm 1, latching direct action A1lr: Alarm 1, latching reverse action O12d: Logical OR Alarms 1 & 2, direct action O12r: Logical OR Alarms 1 & 2, reverse action
Out 2	2	Output 2 Usage: Determines how NPN Output 2 and relay Output 2 operate.	A2_d: Alarm 2, direct action A2_r: Alarm 2, reverse action O12d: Logical OR Alarms 1 & 2, direct action O12r: Logical OR Alarms 1 & 2, reverse action
rt En	E	Re-transmission (Linear) Output: selects the output range. See also Selection of Linear (Re-transmission) Output Range previously.	nonE: None 0-5v: 0 - 5V 1-5v: 1 - 5V 0-10v: 0 - 10V 2-10v: 2 - 10V 0-20A: 0 - 20mA 4-20A: 4 - 20mA

Primary Display	Identifier	Description	Adjustment Range
Optn	O	Option Selection: determines the option fitted and the function of that option.	nonE: None ComS: Serial Communications ScFy: Digital Input - Security Facility

Input Range Codes

Thermocouple Inputs				RTD Inputs			
Input Type	Range Code	Range Min.	Range Max.	Input Type	Range Code	Range Min.	Range Max.
J	100 (°C)	-200	1200	3-wire	800 (°C)	-200	800
	101 (°F)	-328	2192		801 (°F)	-328	1472
	110 (°C)	-128.0	537.0		810 (°C)	-128.0	537.0
	111 (°F)	-198.4	998.6		811 (°F)	-198.4	998.6
T	200 (°C)	-240	400	4-wire	900 (°C)	-200	800
	201 (°F)	-400	752		901 (°F)	-328	1472
	210 (°C)	-128.0	400.0		910 (°C)	-128.0	537.0
	211 (°F)	-198.4	752.0		911 (°F)	-198.4	998.6
K	300 (°C)	-240	1372		The input range can be trimmed using the rnGh and rnGL parameters (see Parameter Sequence) - minimum span = 100°C.		
	301 (°F)	-400	2502				
	310 (°C)	-128.0	537.0				
	311 (°F)	-198.4	998.6				
N	400 (°C)	0	1399				
	401 (°F)	32	2550				
B	500 (°C)	100	1824				
	501 (°F)	212	3315				
R	600 (°C)	0	1760				
	601 (°F)	32	3200				
S	700 (°C)	0	1760				
	701 (°F)	32	3200				

SPECIFICATION

DISPLAY

Type: Red/green, 7-segment LED, 5-digit primary display, 1-digit secondary display.
Height: 18mm (0.71in) primary display, 7mm (0.3in) secondary display..

SENSOR INPUT

Types: Thermocouple (Types B, J, K, N, R, S and T) or RTD (3-wire or 4-wire).
Accuracy: 0.1% of span (CJC error 0.3% typical, 0.5% max.)
Sample Rate: Every 250mS.
Resolution: 14 bits.

Sensor Break Detection: Detected within two seconds. All alarms become active.

Input Impedance: Greater than 100MΩ resistive

DIGITAL INPUT (OPTION)

Voltage-Free Operation: Max. Contact Resistance (Closure) = 50Ω
Min. Contact Resistance (Open) = 5000Ω
TTL-Compatible Operation: Max. Voltage for "0" = 0.8V; Min. Voltage for "0" = -0.6V
Min. Voltage for "1" = 2.0V; Max. Voltage for "1" = 24.0V

TRANSISTOR OUTPUTS

Type: NPN open collector. Output 1 tied to Alarm 1, Output 2 tied to Alarm 2.

RELAY 1 OUTPUT (STANDARD) AND RELAY 2 OUTPUT (OPTION)

Contact Type/Rating: Single pole double throw. 5A resistive @ 120V AC; 3A resistive @ 240V AC.

Lifetime: >500,000 operations at rated voltage/current. Isolation - inherent.

LINEAR (RE-TRANSMITTED PV) OUTPUT (OPTION)

Accuracy: ±0.5% max.
Resolution: 8 bits in 250mS (10 bits in 1 second typically).
Update Rate: 4/second approximately.

Load Impedance: mA ranges - 500Ω max. V ranges - 500Ω min.

OPERATING CONDITIONS FOR INDOOR USE

Ambient Temperature (Operating): 0°C to 55°C
Ambient Temperature (Storage): -20°C to 80°C
Relative Humidity: 20% - 95% non-condensing
Supply Voltage: 100 - 240V AC 50/60Hz (standard) 7.5VA
20 - 50V AC (option) 7.5VA; 22 - 55V DC (option) 5W

ENVIRONMENTAL.

Approvals: CE UL & cUL
EMC Immunity: EN61326-1:2013 Table 2.
EMC Emission: EN61326-1:2013 Class A.
This is a class A product. In a domestic environment this product may cause radio interference in which case the user may be required to take adequate measures.

Safety Considerations: UL61010-1 Edition 3 & EN61010 version 2010.
Front Panel Sealing: To IP66

PHYSICAL

Dimensions: Height - 48mm, Width - 96mm, Depth - 100mm (behind panel)
Weight: 0.21kg max.